




## ECONOFLOW CONTROLLER SETTING

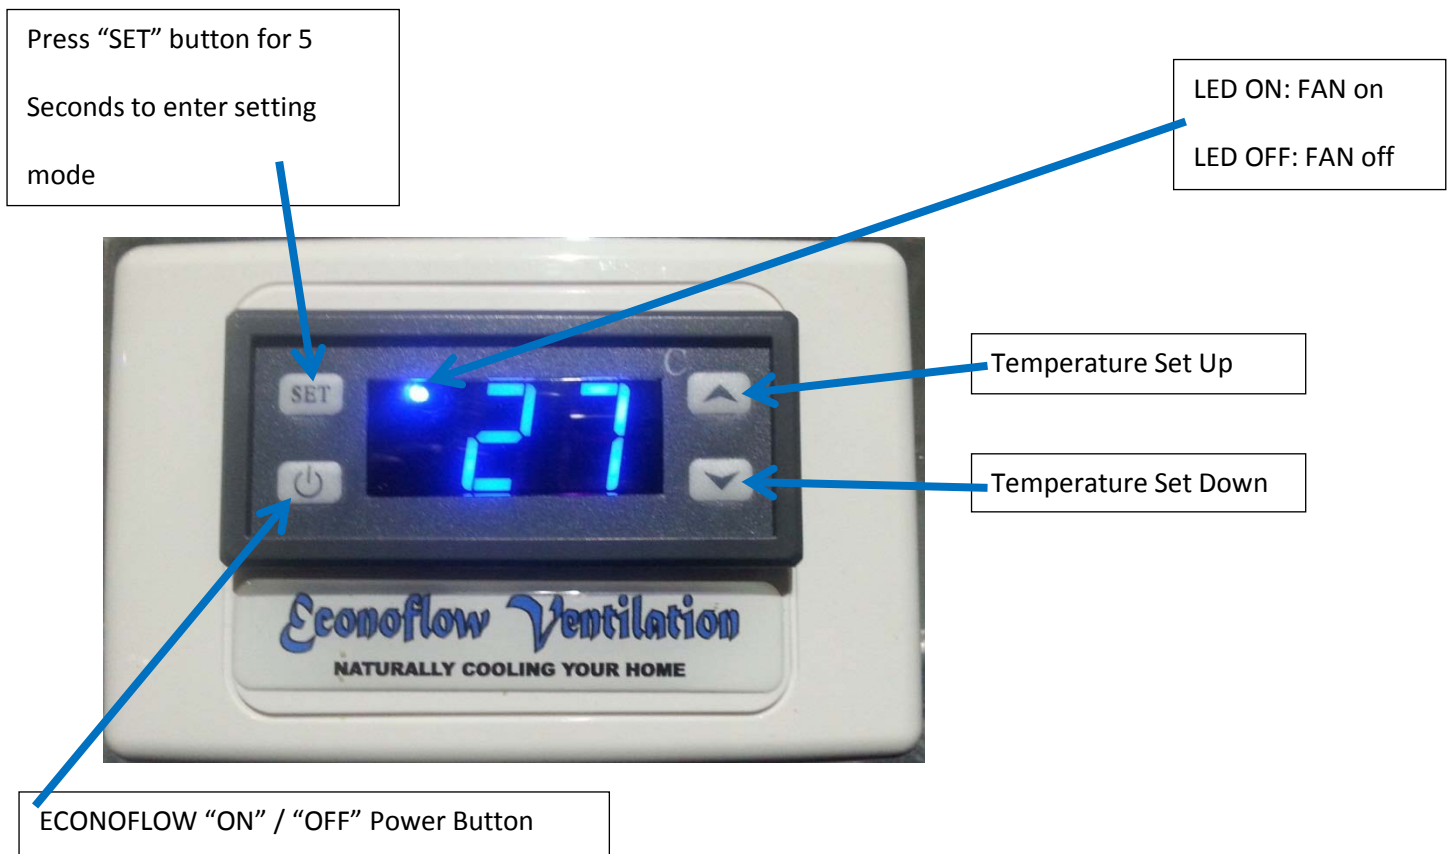

To set the desired temperature ventilation FAN turns on:

- Press and hold "SET" button for 5 seconds till display shows current set temperature
- Use "▲" or "▼" keys to adjust required temperature
- Press "SET" for 5 seconds or wait 15 seconds without key press to return to current roof cavity temperature display. (Please note FAN will turn on 3 degrees above SET temperature. This is to stop FAN continually cycling on and off around set temperature. FAN will continue to run until roof cavity reaches SET temperature. )

To Turn **ECONOFLOW** ON and OFF:

- To turn unit OFF please hold power button for 5 seconds.
- To turn unit ON press power button once quickly.